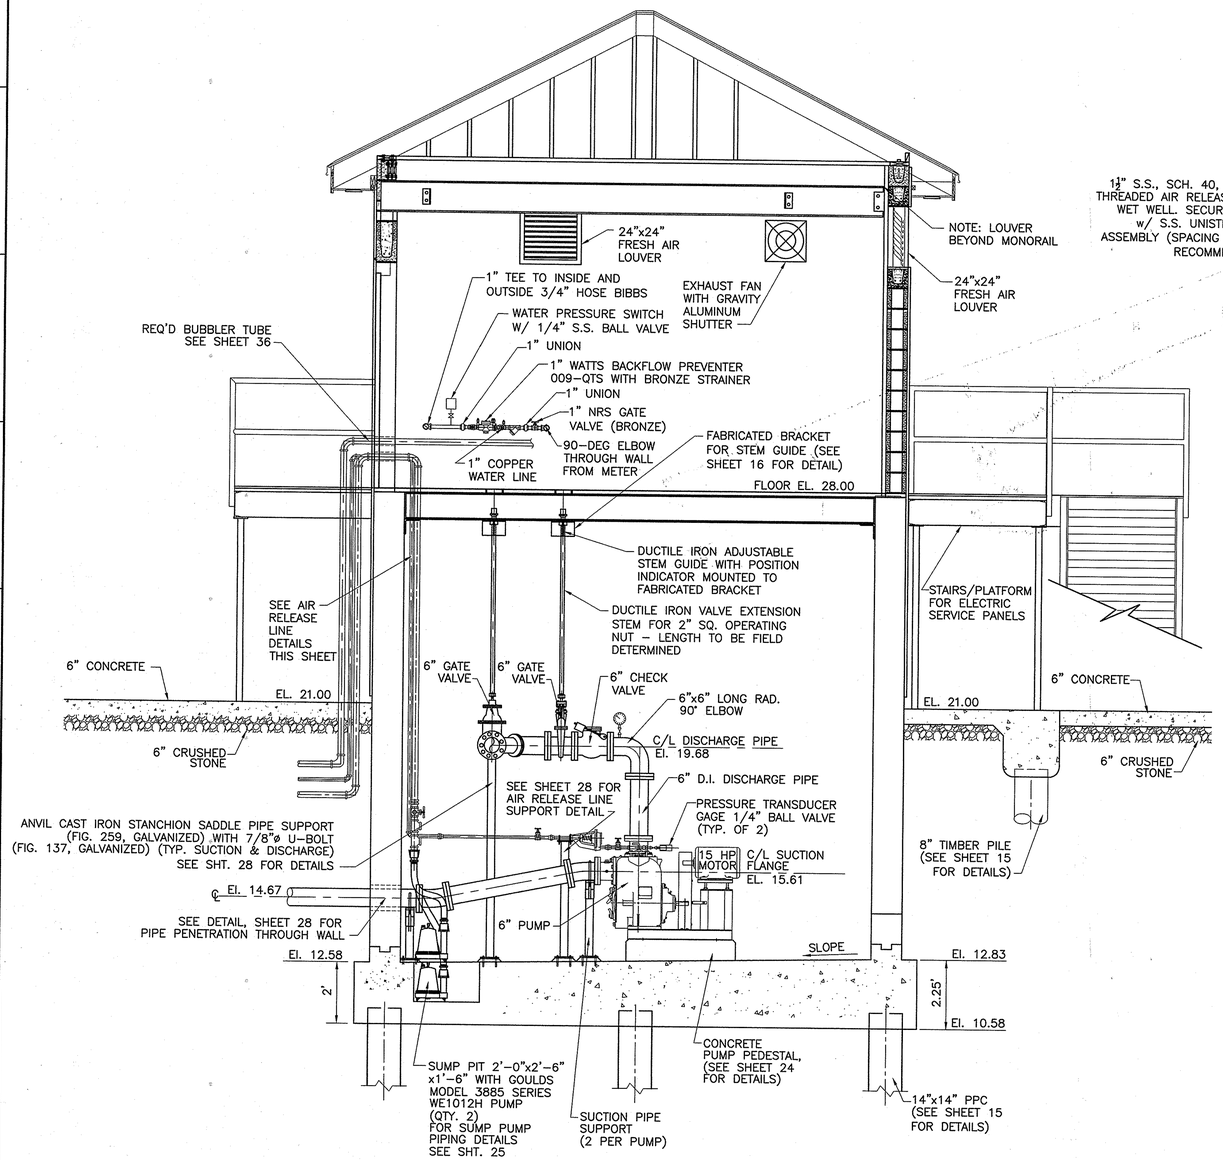

PLUM ORCHARD

B / 4 / 27 LONGITUDINAL SECTION OF BUILDING (LOOKING EAST)

SCALE: 1/2" = 1'-0"

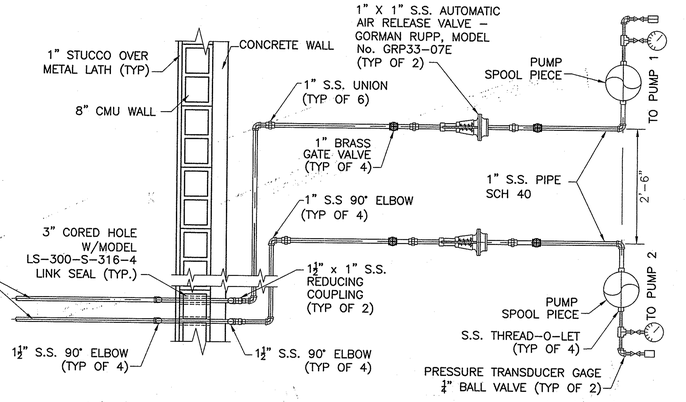

AIR RELEASE LINE PLAN VIEW

SCALE: 3/4" = 1'-0"

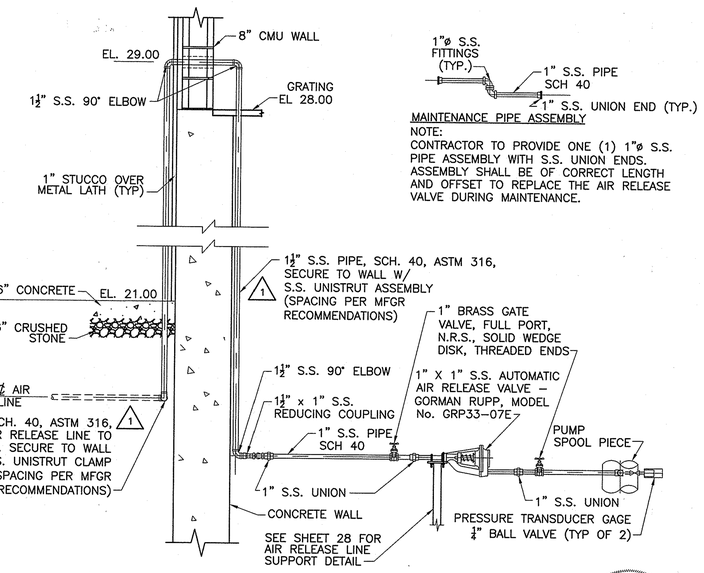

AIR RELEASE LINE ELEVATION

SCALE: 3/4" = 1'-0"

MAINTENANCE PIPE ASSEMBLY

NOTE:
CONTRACTOR TO PROVIDE ONE (1) 1"ø S.S. PIPE ASSEMBLY WITH S.S. UNION ENDS. ASSEMBLY SHALL BE OF CORRECT LENGTH AND OFFSET TO REPLACE THE AIR RELEASE VALVE DURING MAINTENANCE.

MECHANICAL

REV.	DATE	DESCRIPTION	BY
1	07/15/13	ADDENDUM NO. 2 – REVISE CALL OUT TEXT	J.H.

SEWERAGE AND WATER BOARD OF NEW ORLEANS

CONTRACT 3667
HURRICANE KATRINA RELATED
404 HAZARD MITIGATION GRANT PROGRAM
REPLACEMENT OF PLUM ORCHARD SEWAGE LIFT STATION

LONGITUDINAL SECTION

DESIGN ENGINEERING INC.
3330 West Esplanade Ave. S.
Suite 205
Metairie, LA 70002
(504) 836-2155

DR. TH/BD
TRC. – –
CK. DS/CW
AP. JH
SCALE: AS SHOWN
DATE: JANUARY 2012

Joseph Becker
GENERAL SUPERINTENDENT

DWG. No. 12038-W-63
SET NO. SHEET NO. 27

FOR REFERENCE ONLY

PRINTED: Jul 15, 2013 - 1:19pm FILENAME = d:\00003\1-GOSHEP-2013\Contract 3667 - Plum Orchard SPS\SHT 27_P O__LONG SEC.dwg