


FOR REFERENCE
ONLY

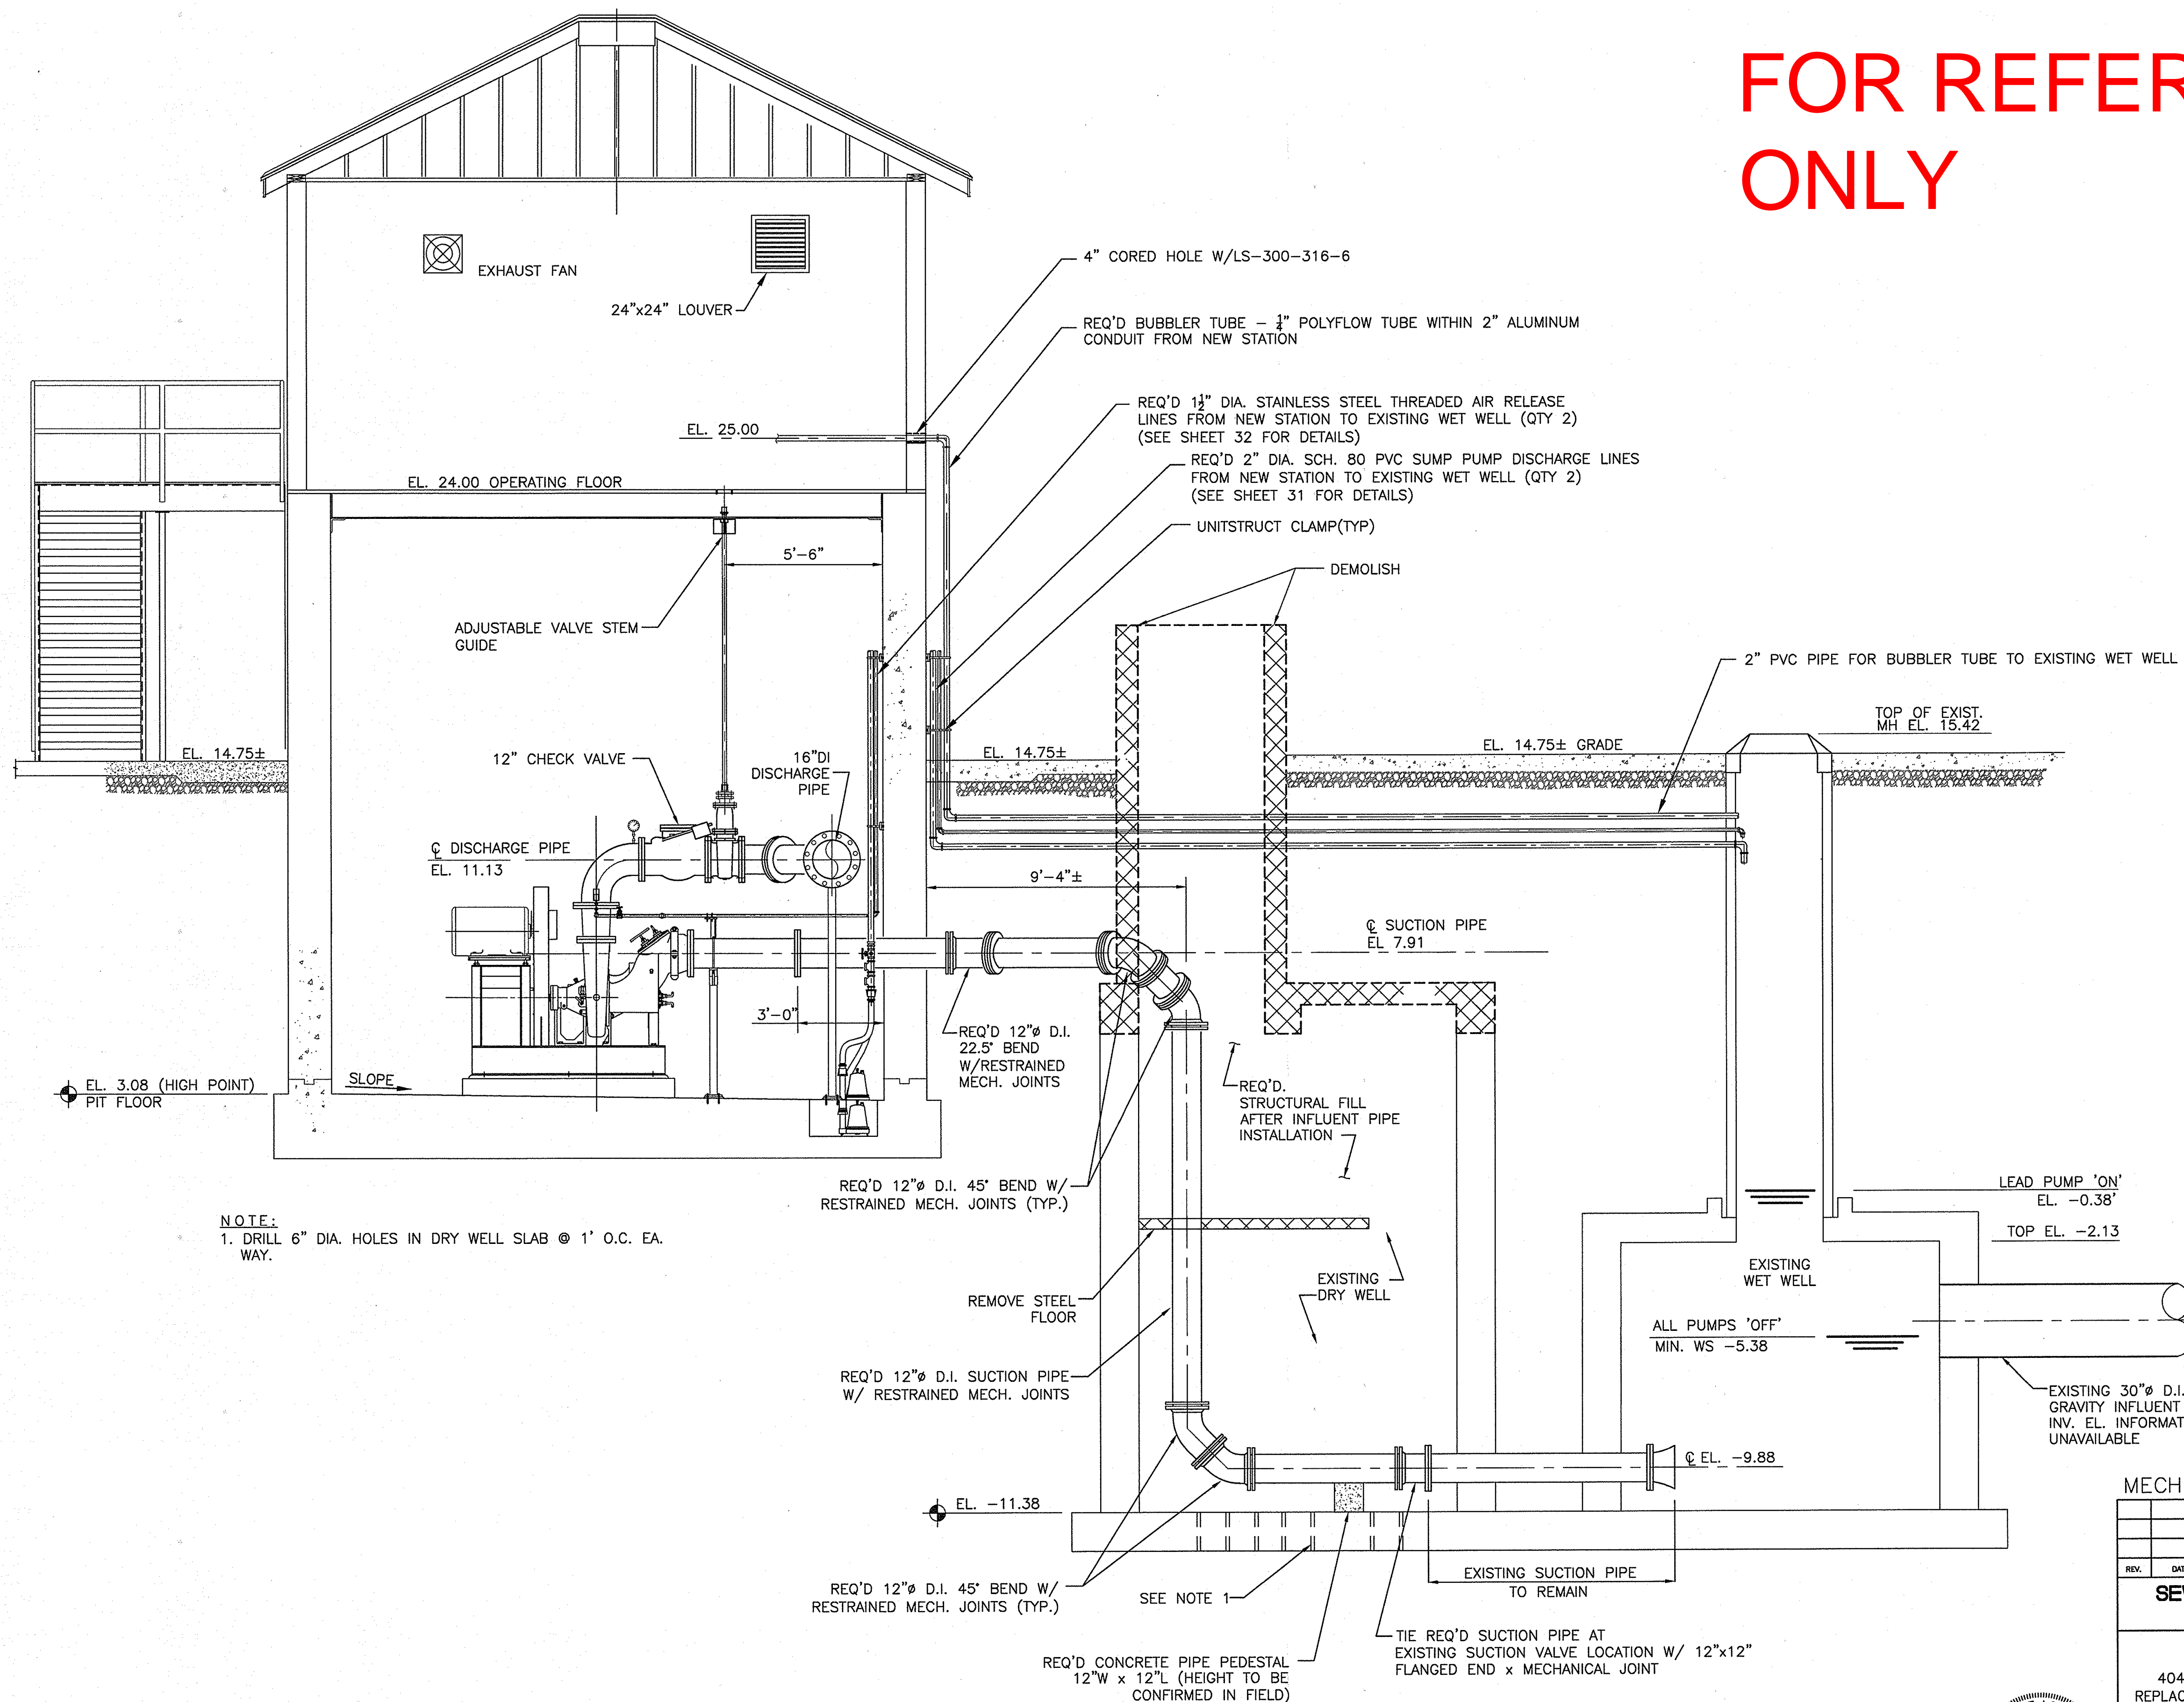

NOTE:
1. DRILL 6" DIA. HOLES IN DRY WELL SLAB @ 1' O.C. EA. WAY.

PUMP STATION CROSS SECTION
SCALE: 1/4" = 1'-0"

MECHANICAL			
REV.	DATE	DESCRIPTION	BY
SEWERAGE AND WATER BOARD OF NEW ORLEANS			
CONTRACT 3788 HURRICANE KATRINA RELATED 404 HAZARD MITIGATION GRANT PROGRAM REPLACEMENT OF BURKE SEWAGE PUMPING STATION			
PIPING CROSS SECTION THROUGH STATION AND WETWELL			
DR. RWYG			
TRC.			
CK. VO			
AP. VTBS			
SCALE: AS SHOWN			
DATE: SEPT. 2013	SET NO.	SHEET NO. 30 OF 47	

RELEASED FOR BID

